

INFORMATION REPORT INFORMATION REPORT

CENTRAL INTELLIGENCE AGENCY

50X1-HUM

This material contains information affecting the National Defense of the United States within the meaning of the Espionage Laws, Title 18, U.S.C. Secs. 793 and 794, the transmission or revelation of which in any manner to an unauthorized person is prohibited by law.

S-E-C-R-E-T

COUNTRY	USSR (Lugansk Oblast)	REPORT		
SUBJECT	The Lisichansk Chemical Combine at Severodonetsk	DATE DISTR.	29 December 1964	50X1-HUM
		NO. PAGES	4	
		REFERENCES		50X1-HUM
DATE OF INFO.				
PLACE & DATE ACQ.				50X1-HUM

THIS IS UNEVALUATED INFORMATION. SOURCE GRADINGS ARE DEFINITIVE. APPRAISAL OF CONTENT IS TENTATIVE.

1. The Lisichansk Chemical Combine is located north of Lisichansk at Severodonetsk [N 48-58, E 38-26] at the head of a bridge over the Donets River. The combine is surrounded by a wall and anyone entering the combine is required to show an entrance permit. Civilian guards, armed with pistols and revolvers, are posted at the main entrance and guards assigned to the various factories carry rifles.
2. Within the combine are a number of chemical plants, including a citric acid plant [redacted] two ammonia plants, 50X1-HUM a nitric acid factory and a urea plant which is under construction. Red fuming nitric acid is also produced, but further details on production processes and materials are not known. An electrical generating station and three steel towers for a high-tension line are located in the combine, but it is not known whether or not the high-tension lines are fed from the generating station. Outside the combine there are also three steel high-tension towers.
3. Floods which occurred at Lisichansk in June and July 1964 had no detrimental effect on operations at the combine as the terrain of the factory area lies some two meters higher than that flooded by the overflowing Donets River.
4. On page 4 is a sketch showing the layout of the combine. 50X1-HUM

S-E-C-R-E-T

50X1-HUM

GROUP 1
Excluded from automatic
downgrading and
declassification

5
3
2
1

STATE	DIA	ARMY	NAVY	AIR	NSA	EXB	NIC		50X1-HUM
-------	-----	------	------	-----	-----	-----	-----	--	----------

(Note: Field distribution indicated by "#")

INFORMATION REPORT INFORMATION REPORT

Page Denied

S-E-C-R-E-T

50X1-HUM

-3-

Object Index for Chemical Combine

1. Lisichansk Chemical Combine at Severodonetsk. The combine is surrounded by a wall which is marked by a heavy line.
2. Main building of the combine.
3. Main entrance of the combine.
4. Drawing room.
5. Elevated bridge over the road connecting the drawing room and the administration building.
6. Administration building.
7. A citric acid factory [redacted] 50X1-HUM
8. Two-lane asphalt road.
9. High chimney for the removal of nitrous fumes from the nitric acid factory. A heavy red-brown smoke comes out of this chimney.
10. Ammonia factory.
11. Nitric acid factory.
12. Ammonia factory. This factory is smaller than the one noted under point 10.
13. Urea factory under construction.
14. Unidentified factory.
15. Railroad track, double rails.
16. Generating station of the combine.
17. Water pumping station. Cool water is supplied to the combine via this station.
18. Entrance and exit of the combine.
19. Water towers.
20. Steel mast towers for high-tension cable on the grounds of the combine.
21. Steel mast towers for high-tension cable outside the grounds of the combine.

S-E-C-R-E-T


NO FOREIGN DISSEM/NO DISSEM ABROAD

S-E-C-R-E-T

- 4 -

50X1-HUM

Lisichansk Chemical Combine

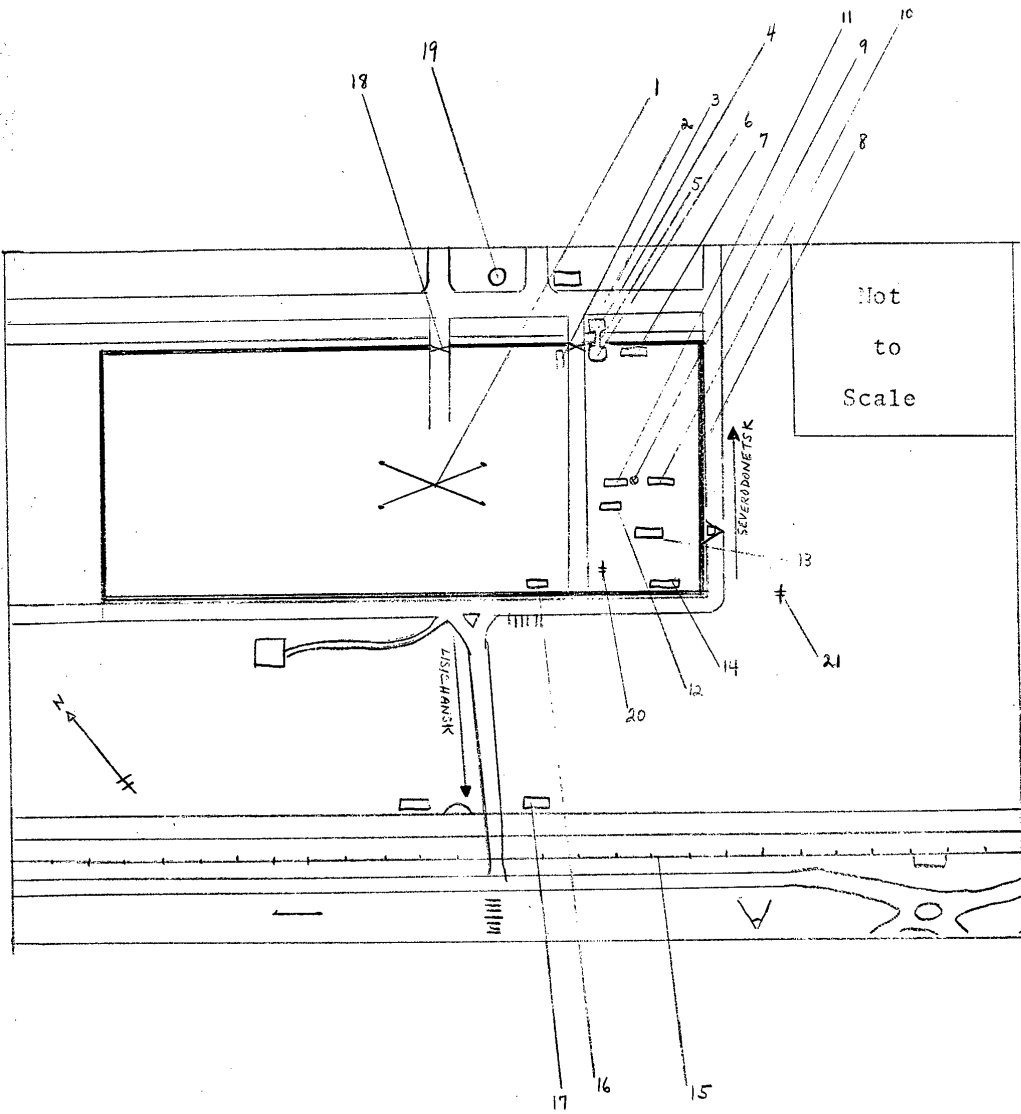

S-E-C-R-E-T

50X1-HUM