

25X1A

Approved For Release 2000/06/08 : CIA-RDP82-00457R0100001000
CLASSIFICATION **CONFIDENTIAL**

14204A5

COUNTRY Germany (Soviet Zone) SECURITY INFORMATION REPORT NO. [REDACTED]

TOPIC Prepared Alternate Command Post at Ruedersdorf-Kalkberge [REDACTED]

25X1C

25X1X EVALUATION [REDACTED] PLACE OBTAINED [REDACTED]

25X1C DATE OF CONTENT [REDACTED]

DATE OBTAINED [REDACTED] PREPARED 13 December 1951

25X1A REFERENCES [REDACTED]

PAGES 1 ENCLOSURES (NO. & TYPE)

REMARKS

25X1X

SOURCE [REDACTED]

25X1C 1. During the night of 24 October 1951, all but eight men of the guard detachment at the alternate command post in Ruedersdorf-Kalkberge (N 53/V 40) were replaced. The personnel of the departing guard detachment wore red-bordered black epaulets, including some with signal insignia. The new guard detachment consisted of 120 soldiers, who wore black-bordered black epaulets and arrived on [REDACTED] which made several trips. The unit was under the command of Captain Nivitski. Nivitski was allegedly reduced to the rank of senior lieutenant after two colonels had found him drunk while making an inspection in mid-October. The ceremony, when the unit was changed, was witnessed by two colonels and a third field-grade officer.

25X1C 2. Two to four times a week, the alternate command post in the Reden Tunnel was inspected by two colonels who rode in [REDACTED]. Each inspection lasted two to three hours. Civilians were evicted in October from a three-story building in front of the main tunnel entrance, the building was then occupied by Soviet officers. The main entrance was continually guarded by eight sentries, while the military reservation on top and around the underground installation was patrolled by about 40 sentries carrying submachine guns. Every night at 11 p.m., the troops of the guard detachment, who were not on duty, fell in at the main entrance and went through a 5 to 10 minute drill. [REDACTED] were repeatedly seen hauling in ration supplies.

25X1X 3. [REDACTED] and a photograph of the main gate. The photograph was taken prior to the removal of the inner arch over the main entrance of the tunnel which was done to enlarge the entrance, and the installation of heavy wooden doors.

25X1C [REDACTED]

CONFIDENTIAL

REFERENCE COPY

CLASSIFICATION **CONFIDENTIAL** CONTROL ONLY

Document No.	003
No Change in Class.	<input type="checkbox"/>
<input type="checkbox"/> Declassified	
Class. Changed To:	TS S C
Auth: HR 70.2	
Date:	1978 29 015


CONFIDENTIAL

SECRET//SI//US OFFICIALS ONLY

Annex 1 to [REDACTED]



Heintz - See

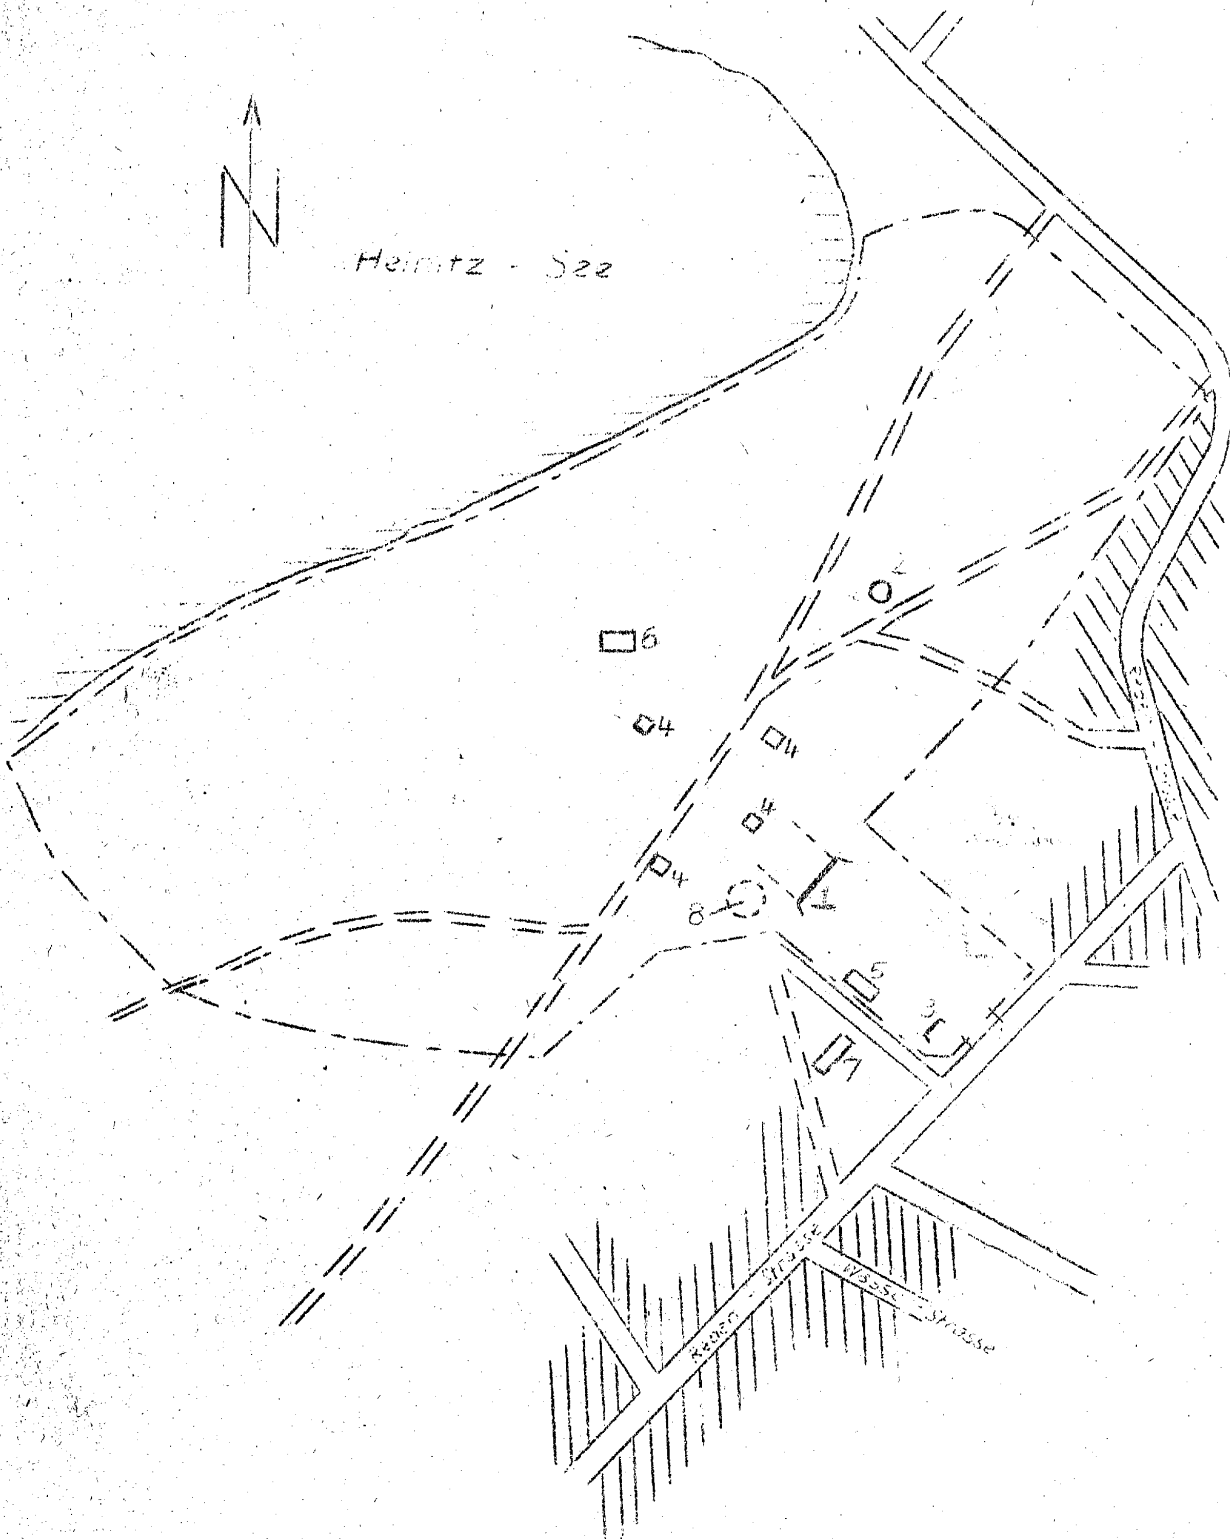

Scale about 1:2,500

NO KEY TO NUMBERS WAS SUBMITTED

CONFIDENTIAL



SECRET//SI//US OFFICIALS ONLY